


- ⑥ See Standard Drawing E 604-SWCR-02 for groove details.
- ⑦ See Standard Drawing E 604-SWCR-02 for details of the detectable warnings.
- ⑧ A minimum 4'-0 landing area shall be provided at the bottom of the ramp for wheelchair users.
- ⑨ Indicated area denotes pay limits.

- ⑩ Curb or wall shall be used when necessary based on field conditions.
11. See Standard Drawings E 604-SWCR-03 for typical ramp construction details.
12. See Standard Drawings E 604-SWCR-01 and -02 for Location Plan and General Notes respectively.

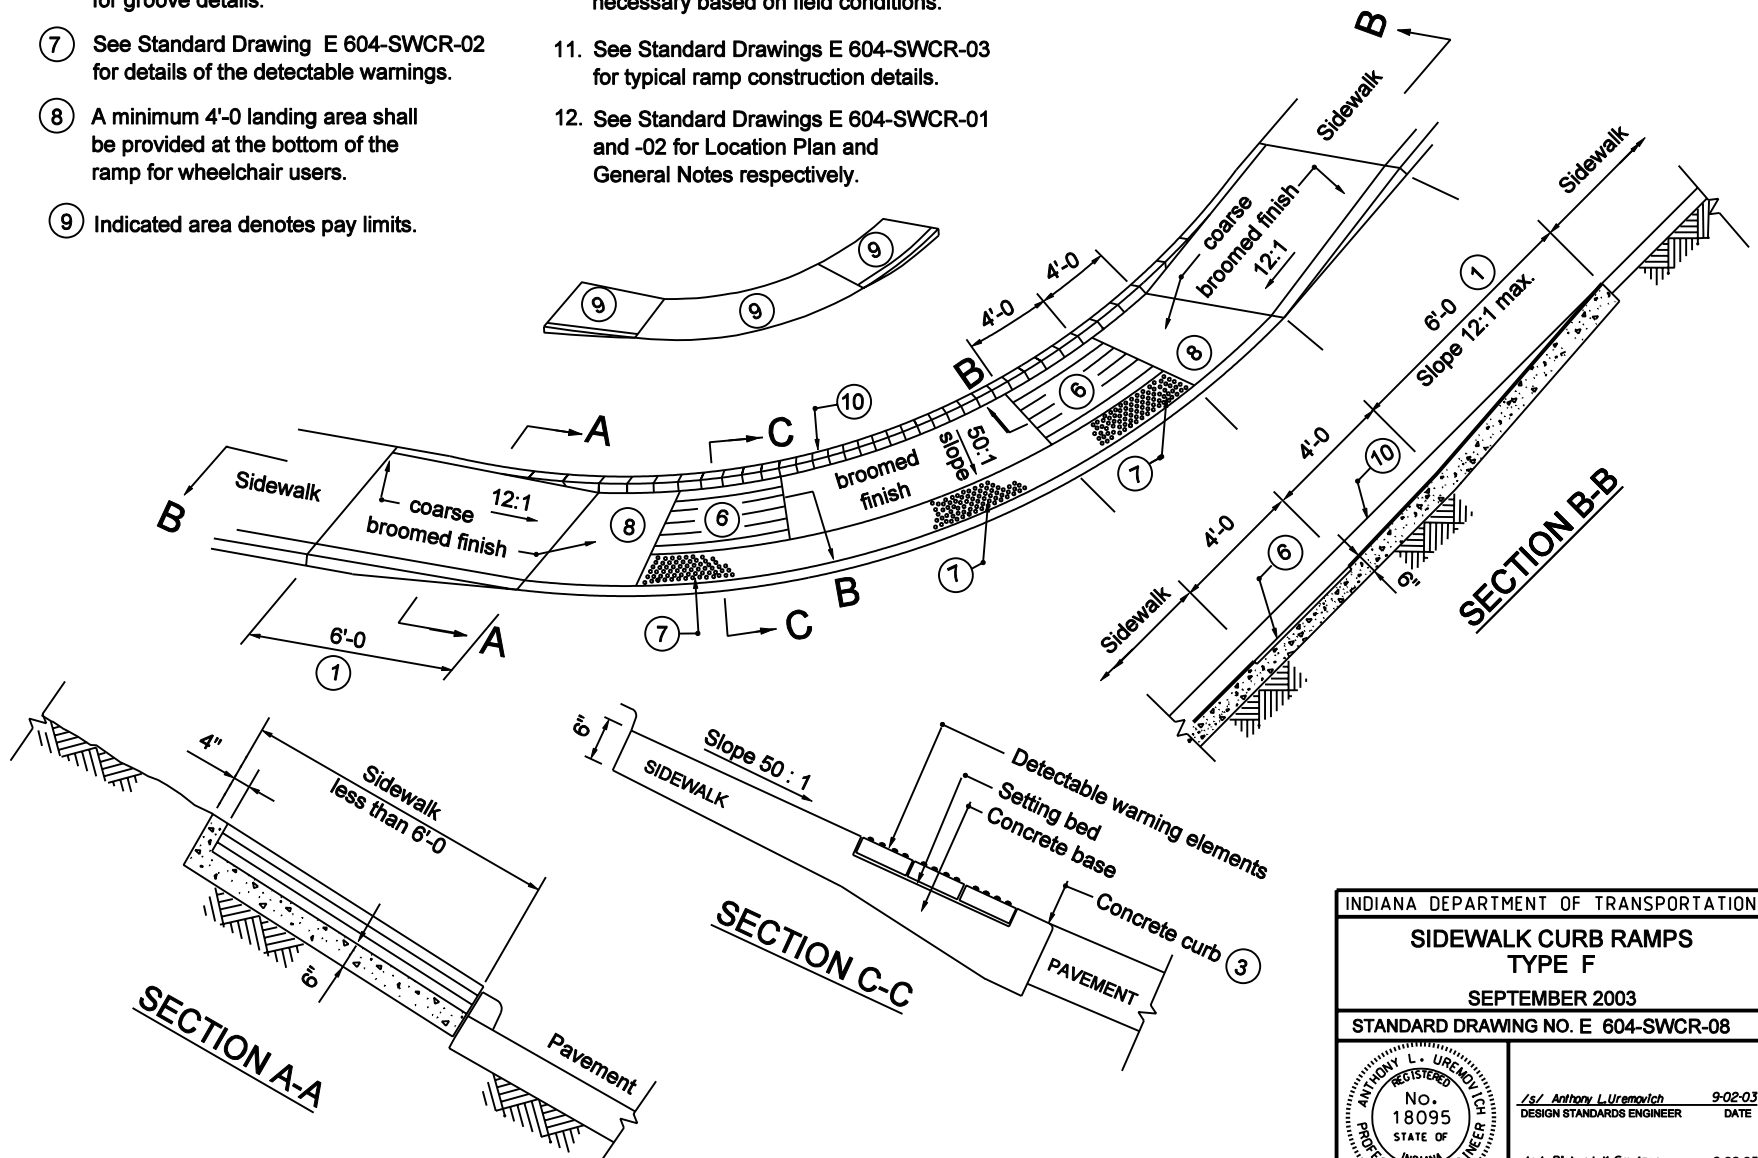

/s/ Richard K. Smutzer 9-02-03
CHIEF HIGHWAY ENGINEER DATE

DESIGN STANDARDS ENGINEER